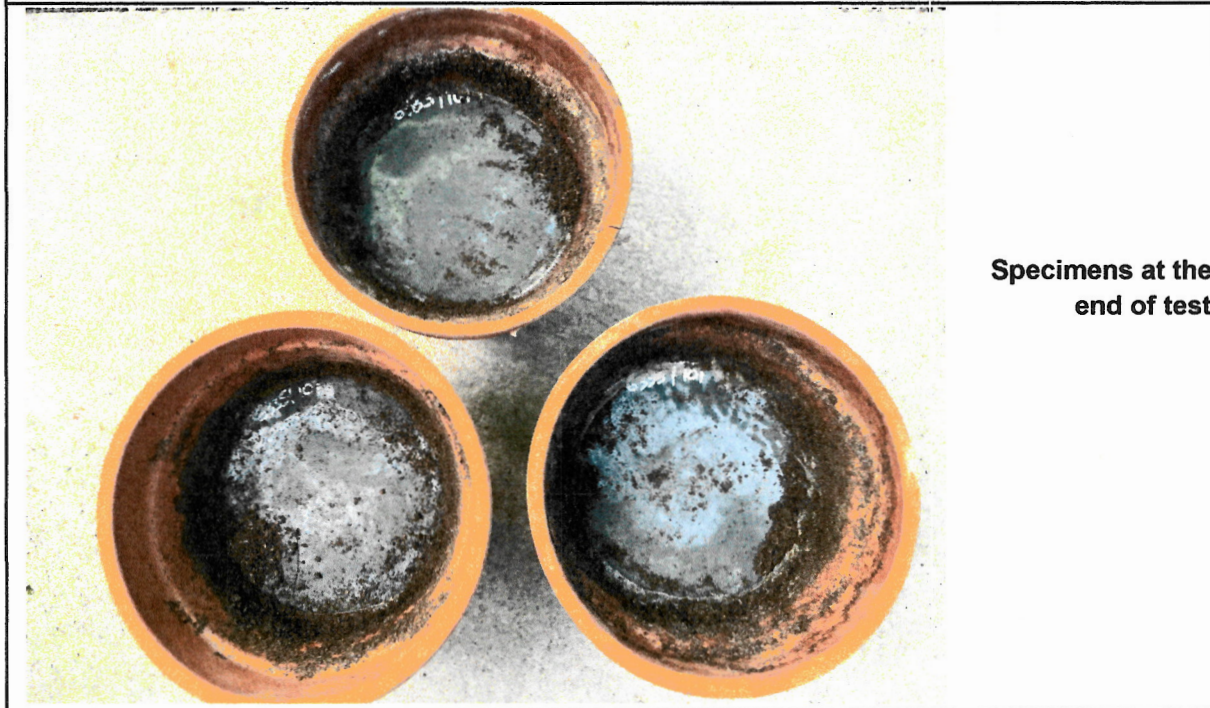


INFRASTRUCTURE**FERRARA DEPARTMENT**Via Annibale Zucchini, 69 – 44122 Ferrara (FE)
Tel.: +39 0532 56771 - Fax.: +39 0532 56119SOCOTEC ITALIA Srl – P.Iva 01872430648 - Capitale sociale 7.144.000,00 euro
Sede Legale: Via Bariola, 101-103 - 20045 Lainate (MI)
Tel.: +39 02 9375 0000 - Fax: +39 02 9375 0099
www.socotec.it

CUSTOMER: BASF Polyurethanes GmbH
ADDRESS: Elastogranstraße 60 - DE 49448 Lemförde
SAMPLE: ELASTOCOAT C 6335/101
WORK NUMBER: SI_2022_0195
PROT. N. LF47815/23 rev.0 of 03/05/23

TEST METHOD FOR DETERMINING THE RESISTANCE TO ROOTS - UNI CEN/TS 14416

Test N°	Test piece dimensions (mm)	Testing time (days)	Evaluation at the end of test
1	∅ 220 x 3	56	The roots have not penetrated
2	∅ 220 x 3	56	The roots have not penetrated
3	∅ 220 x 3	56	The roots have not penetrated
4 - Control specimen in bitumen 85/40	∅ 220 x 20	56	The roots have penetrated the bitumen

**NOTE:**

Test carried out on sample applied by customer .
 Date of testing: 01/03/23 ÷ 26/04/23
 Internal code equipments used: 1603.

Technological Laboratory Senior Manager
 p.i. Paolo Bet

A handwritten signature in blue ink, appearing to read 'Paolo Bet'.

Engineer
 dott. Alessandro Marzola

A handwritten signature in blue ink, appearing to read 'Alessandro Marzola'.